

Document No.: ARLATL1270525 / 20251408
 Visit No: 2
 Year: 2025
 Office: Trim

EPA Licence No.: W0004-04
 Licence Holder: South Dublin County Council, AR08
 Facility Location: Arthurstown Landfill
 Rev.No: 1



Report Title	Air Emissions Compliance Monitoring Emissions
Company address	Air Scientific Ltd., 32 DeGranville Court, Dublin road, Trim, Co. Meath
Stack Emissions Testing Report Commissioned by	South Dublin County Council
Facility Name	Arthurstown Landfill
Contact Person	Mr. Ben Frost
EPA Licence Number	W0004-04
Licence Holder	South Dublin County Council, AR08
Stack Reference Number	AR08
Dates of the Monitoring Campaign	27/05/2025
Job Reference Number	ARLATL1270525 / 20251408
Report Written By	Amanda Sheridan
Report Approved by	Dr. Brian Sheridan
Stack Testing Team	Dr. John Casey
Report Date	25/06/2025
Report Type	Test Report Compliance Monitoring
Version	1
Signature of Approver	 Brian Sheridan Technical Manager



Contents

1. Executive Summary	2
I. Monitoring Objectives	2
Overall Aim of the monitoring Campaign	2
Special Requirements	2
Target Parameters	2
Emission Limit Values	3
Reference Conditions	3
Overall Results	4
Accreditation details	5
Monitoring Dates & Times	6
Monitoring, Equipment & Analytical Methods	7
Sampling Deviations	9
Reference Documents	9
Suitability of sampling location	10
Process details	11
Stack diagram	12
2. APPENDICES	13
II. Appendix I - Monitoring Personnel & Equipment	13
Stack Emissions Monitoring Personnel	13
III. Appendix II - Stack Details & flow characteristics	14
Preliminary stack survey calculations	14
IV. Appendix III - Individual parameter sampling details and results	20
Carbon Monoxide Quality Assurance	20
Carbon Monoxide Results & Sampling details	23
Carbon Monoxide Trend	27
Carbon Monoxide Measurement Uncertainty	28
Oxides of Nitrogen Quality Assurance	29
Oxides of Nitrogen Results & Sampling details	31
Oxides of Nitrogen Trend	35
Oxides of Nitrogen Measurement Uncertainty	37
Oxygen Quality Assurance	38
Oxygen Trend	40
Carbon Dioxide Quality Assurance	41
Carbon Dioxide Sampling Details & Results	41
Carbon Dioxide Trend	43
Uncertainty Sheets	44

*Opinions and interpretations expressed herein are outside the scope of Air Scientific Limited INAB accreditation.
This test report shall not be reproduced, without the written approval of Air Scientific Limited. All sampling
and reporting is completed in accordance with Environmental Protection Agency Air Guidance Note 2 requirements.*

Document No.: ARLATL1270525 / 20251408
Visit No: 2
Year: 2025
Office: Trim

EPA Licence No.: W0004-04
Licence Holder: South Dublin County Council, AR08
Facility Location: Arthurstown Landfill
Rev.No: 1

1. Executive Summary

1. Monitoring Objectives

Overall Aim of the monitoring Campaign

The aim of the monitoring campaign was to demonstrate compliance with a set of emission limit values as specified in the site licence.

Special Requirements

There were no special requirements.

Target Parameters

Carbon Monoxide (CO)
Oxides of Nitrogen (NOx) as NO ₂
Stack Gas Temperature
Volume (m ³ .h ⁻¹)
Oxygen (O ₂)
Carbon Dioxide (CO ₂)

Document No.: ARLATL1270525 / 20251408
Visit No: 2
Year: 2025
Office: Trim

EPA Licence No.: W0004-04
Licence Holder: South Dublin County Council, AR08
Facility Location: Arthurstown Landfill
Rev.No: 1

Emission Limit Values

Emission Limit Values / Mass Emissions Limit Values	mg.m ⁻³	kg.h ⁻¹
CO	1400	-
NOx as NO ₂	500	-
Stack Gas Temperature	-	-
Volume (m ³ .h ⁻¹)	3,000	-

Reference Conditions

Reference Condition	Value
Oxygen Reference %	5
Temperature K	273.15
Total Pressure kPa	101.3
Moisture Correction	Yes

Executive Summary

Overall Results

Parameter	Concentration	Result	MU +/-	Blanks	Limit	Compliant	Mass Emission	Run 1			O2 Ref. (%)	Accreditation	LOD		
	Units						Units	Result	Limit	Dates				Time on	Time off
CO EN15058:2017	mg.m ⁻³	1237.95	-	-	1400	N/A	kg.h ⁻¹	-	-	27/05/2025	09:42:00	10:13:00	5	Yes	<1.7
NOx EN14792:2017	mg.m ⁻³	287.24	-	-	500	N/A	kg.h ⁻¹	-	-	27/05/2025	09:42:00	10:13:00	5	Yes	<1.8
Oxygen (%) EN14789:2017	% v/v	8.04	0.33	-	-	N/A	-	-	-	27/05/2025	09:42:00	10:13:00	5	Yes	-
CO ₂ ISO12039:2001	% v/v	10.72	0.35	-	-	N/A	-	-	-	27/05/2025	09:42:00	10:13:00	5	Yes	-
Stack Gas Temperature	K	-	-	-	-	N/A	-	-	-	27/05/2025	09:35:00	09:38:00	5	Yes	-
Stack Gas Velocity EN16911:2013	m.s ⁻¹	-	-	-	-	N/A	-	-	-	27/05/2025	09:35:00	09:38:00	5	N/A	-
Volumetric Flow Rate	m ³ .h ⁻¹	-	-	-	3,000	N/A	-	-	-	-	-	-	5	N/A	-
Volumetric Flow Rate (Ref)	m ³ .h ⁻¹	-	-	-	3,000	N/A	-	-	-	-	-	-	5	N/A	-

Accreditation details

Air Scientific Limited	INAB319T
External Analytical Laboratory	UKAS0605
Other	-



Document No.: ARLATL1270525 / 20251408

EPA Licence No.: W0004-04

Visit No: 2

Licence Holder: South Dublin County Council, AR08

Year: 2025

Facility Location: Arthurstown Landfill

Office: Trim

Rev.No: 1

Executive Summary

Monitoring Dates & Times

Parameter	Run	Location ID	Sampling Dates	Sampling Time On	Sampling Time Off	Duration (mins.)
Carbon Monoxide (CO)	Run 1	AR08	27/05/2025	09:42:00	10:13:00	00:31:00
	Run 2	-	-	-	-	-
	Run 3	-	-	-	-	-
Oxides of Nitrogen (NOx) as NO ₂	Run 1	AR08	27/05/2025	09:42:00	10:13:00	00:31:00
	Run 2	-	-	-	-	-
	Run 3	-	-	-	-	-
Oxygen (%)	Run 1	AR08	27/05/2025	09:42:00	10:13:00	00:31:00
	Run 2	-	-	-	-	-
	Run 3	-	-	-	-	-
Stack Gas Temperature		AR08	27/05/2025	09:35:00	09:38:00	00:03:00
Stack Gas Velocity		AR08	27/05/2025	09:35:00	09:38:00	00:03:00
Carbon Dioxide (%)	Run 1	AR08	27/05/2025	09:42:00	10:13:00	00:31:00
	Run 2	-	-	-	-	-
	Run 3	-	-	-	-	-

Document No.: ARLATL1270525 / 20251408
 Visit No: 2
 Year: 2025
 Office: Trim

EPA Licence No.: W0004-04
 Licence Holder: South Dublin County Council, AR08
 Facility Location: Arthurstown Landfill
 Rev.No: 1

Executive Summary

Monitoring, Equipment & Analytical Methods

Parameter	Monitoring			Analysis		
	Standard	Technical Procedure	Accredited Testing	Testing Lab	Analytical Technique	INAB Analysis
Carbon Monoxide (CO)	EN15058:2017	SOP 2004	Yes	AirSci	NCIR By Horiba PG-250	-
Oxides of Nitrogen (NOx)	EN14792:2017	SOP 2002	Yes	AirSci	Chemiluminescence	-
Oxygen (%)	EN14789:2017	SOP 2008	Yes	AirSci	Paramagnetic	-
Carbon Dioxide	ISO12039:2001	SOP 2045	Yes	AirSci	NDIR	-
Stack Gas Temperature	EN16911:2013	SOP 2005	Yes	AirSci	Thermocouple	-
Stack Gas Velocity	EN16911:2013	SOP 2005	N/A	AirSci	Pitot tubes	-

Document No.: ARLATL1270525 / 20251408

Visit No: 2

Year: 2025

Office: Trim

EPA Licence No.: W0004-04

Licence Holder: South Dublin County Council, AR08

Facility Location: Arthurstown Landfill

Rev.No: 1

List of Equipment

ID	Item of Equipment	Manufacturer	Serial No.
ASLTM12EQ513	Horiba PG2500 Portable Gas Analyser	Horiba	ZVM969TT
ASLTM13EQ509	10 metre industrial heated sample line	Neptech	13B088
ASLTM14EQ511	Buhler Sample Gas Cooler	Buhler Technologies	100094941
ASLTM20EQ505	K type thermocouple	TC Direct	109710/1C
ASLTM19EQ509	Kimo Manometer	Kimo	N/A

Document No.: ARLATL1270525 / 20251408
Visit No: 2
Year: 2025
Office: Trim

EPA Licence No.: W0004-04
Licence Holder: South Dublin County Council, AR08
Facility Location: Arthurstown Landfill
Rev.No: 1

Sampling Deviations

Parameter	Deviation
Standard ID	-

Reference Documents

Risk Assessment (RA)	SOP1011
Site Review (SR)	SOP1015
Site Specific Protocol (SSP)	SOP1015

Document No.: ARLATL1270525 / 20251408
 Visit No: 2
 Year: 2025
 Office: Trim

EPA Licence No.: W0004-04
 Licence Holder: South Dublin County Council, AR08
 Facility Location: Arthurstown Landfill
 Rev.No: 1

Executive Summary

Suitability of sampling location

General Information	Value
Permanent/Temporary	Temporary
Inside/ Outside	Outside

Platform Details		
Irish EPA Technical Guidance Note AG1 / BS EN 15259 Platform Requirements	Value	Comment
Sufficient Working area to manipulate probe and measuring instruments	Yes	-
Platform has 2 handrails (approx. 0.5m & 1.0 m high)	Yes	-
Platform has vertical base boards (approx. 0.25 m high)	Yes	-
Platform has chains / self closing gates at top of ladders	Yes	-
There are no obstructions present which hamper insertion of sampling equipment	No	-
Safe Access Available	Yes	-
Easy Access Available	Yes	-

Sampling Location / Platform Improvement Recommendations
None

BSEN 15259 Homogeneity Test Requirements
1: There is no requirement to perform a BSEN15259 Homogeneity Test on this stack

Process details

Parameter	
Process status	Normal
Capacity (per/hour) (if applicable)	1000KW
Continuous or Batch Process	Continuous
Feedstock	Process Air
Abatement System	No
Abatement Systems Running Status	Normal
Fuel	LFG
Plume Appearance	No
Other information	None

Document No.: ARLATL1270525 / 20251408

EPA Licence No.: W0004-04

Visit No: 2

Licence Holder: South Dublin County Council, AR08

Year: 2025

Facility Location: Arthurstown Landfill

Office: Trim

Rev.No: 1

The process information below has been supplied by the client and as such ASL assume no responsibility or liability for any errors or omissions in the content of this Process Detail Form. The information provided in this form is provided on an 'as is' basis with no guarantees of completeness, accuracy or reliability.

Licensee			
Reg. number	W0004-04	Contractor	Air Scientific Ltd.
Site Contact	Mr. Ben Frost	Contractor's contact	Amanda Sheridan
Role		Role	-
Signature		Signature	-

Emissions point		-				
Type of process		Load of process	Abatement system		List of Solvents used per process	
Rotogravure Printing	-	as normal	Bag filter	-	-	-
Cement Plant	-		Electrostatic precipitator	-	-	-
Electrical generation	-		Cyclone	-	-	-
Steam boiler	-		Thermal oxidiser	-	-	-
Other	Yes		Active carbon bed	-	-	-
			NSCR	-	-	-
			SCR	-	-	-
			Dry scrubber	-	-	-
			Wet scrubber	-	-	-
			Lime injection	-	-	-
			Biofilter	-	-	-
			None	-	-	-
			Other:	-	-	-

Document No.: ARLATL1270525 / 20251408
Visit No: 2
Year: 2025
Office: Trim

EPA Licence No.: W0004-04
Licence Holder: South Dublin County Council, AR08
Facility Location: Arthurstown Landfill
Rev.No: 1

Executive Summary

Stack diagram



Document No.: ARLATL1270525 / 20251408
Visit No: 2
Year: 2025
Office: Trim

EPA Licence No.: W0004-04
Licence Holder: South Dublin County Council, AR08
Facility Location: Arthurstown Landfill
Rev.No: 1

2. APPENDICES

II. Appendix I - Monitoring Personnel & Equipment

Stack Emissions Monitoring Personnel

Team Leader	Name	Dr. John Casey
	Qualifications	PhD. (Eng.), MSc. (Agr.), B. Agr. Sc.
	System approval	Air Scientific Limited Approved
		-
Team Leader	Name	-
	Qualifications	-
	System approval	-
		-

Document No.: ARLATL1270525 / 20251408
 Visit No: 2
 Year: 2025
 Office: Trim

EPA Licence No.: W0004-04
 Licence Holder: South Dublin County Council, AR08
 Facility Location: Arthurstown Landfill
 Rev.No: 1

III. Appendix II - Stack Details & flow characteristics

Preliminary stack survey calculations

General Stack Details		
Stack details	Units	Value
Date of survey		27/05/2025
Time of survey		09:35
Type		Circular
Stack Diameter / Depth, D	m	-
Stack Width, W	m	-
Average Stack Gas Temp., Ta	C	-
Average Static Pressure, P static	kPa	-
Average Barometric Pressure, Pb	kPa	-
Type of Pitot		-
Are Water Droplets Present?		-
Average Pitot Tube Calibration Coeff, Cp		-
Negative flow		-
Highly homogeneous flow stream/gas velocity		Yes

Sample Port Size	mm	-
Initial Pitot Leak Check	Pa	-
Final Pitot Leak Check	Pa	-
Orientation of Duct		Vertical
Pitot Tube Cp		0.998
Number of Lines Available		-
Number of Lines Used		-

Document No.: ARLATL1270525 / 20251408

Visit No: 2

Year: 2025

Office: Trim

EPA Licence No.: W0004-04

Licence Holder: South Dublin County Council, AR08

Facility Location: Arthurstown Landfill

Rev.No: 1

Sampling Line A						
Point	Distance to duct (m)	Pa	Temp °C	Velocity (m/s)	Oxygen (%)	Angle of Swirl
1	-	-	-	-	-	-
2	-	-	-	-	-	-
3	-	-	-	-	-	-
4	-	-	-	-	-	-
5	-	-	-	-	-	-
6	-	-	-	-	-	-
7	-	-	-	-	-	-
8	-	-	-	-	-	-
9	-	-	-	-	-	-
10	-	-	-	-	-	-
Average	-	-	-	-	-	-
Min	-	-	-	-	-	-
Max	-	-	-	-	-	-

Document No.: ARLATL1270525 / 20251408

Visit No: 2

Year: 2025

Office: Trim

EPA Licence No.: W0004-04

Licence Holder: South Dublin County Council, AR08

Facility Location: Arthurstown Landfill

Rev.No: 1

Sampling Line B						
Point	Distance to duct (m)	Pa	Temp °C	Velocity (m/s)	Oxygen (%)	Angle of Swirl
1	-	-	-	-	-	-
2	-	-	-	-	-	-
3	-	-	-	-	-	-
4	-	-	-	-	-	-
5	-	-	-	-	-	-
6	-	-	-	-	-	-
7	-	-	-	-	-	-
8	-	-	-	-	-	-
9	-	-	-	-	-	-
10	-	-	-	-	-	-
Average	-	-	-	-	-	-
Min	-	-	-	-	-	-
Max	-	-	-	-	-	-

Document No.: ARLATL1270525 / 20251408

Visit No: 2

Year: 2025

Office: Trim

EPA Licence No.: W0004-04

Licence Holder: South Dublin County Council, AR08

Facility Location: Arthurstown Landfill

Rev.No: 1

Component	Conc. ppm	Conc. Dry % v/v	Conc. Wet % v/v	Molar Mass
Carbon Dioxide CO ₂	-	10.72	-	44.01
Oxygen O ₂	-	8.03	-	32
Nitrogen N ₂	-	81.24	-	28.1
Moisture (H ₂ O)	-	-	11.6	18.02
Reference Conditions				
Reference Conditions	Units	Numbers		
Temperature	°C	273.15		
Total Pressure	kPa	101.3		
Moisture	%	-		
Oxygen (Dry)	%	5		

Document No.: ARLATL1270525 / 20251408

Visit No: 2

Year: 2025

Office: Trim

EPA Licence No.: W0004-04

Licence Holder: South Dublin County Council, AR08

Facility Location: Arthurstown Landfill

Rev.No: 1

Stack Gas Composition & Molecular Weights								
Component	Molar Mass M	Density Kg/m ³ p	Conc. Dry % v/v	Dry Volume Fraction r	Dry Conc. kg/m ³ pi	Conc. wet % v/v	Wet Volume Fraction r	Wet Conc. kg/m ³ pi
Carbon Dioxide CO ₂	44.01	1.96	10.72	0.1072	0.21	9.48	0.09	0.19
Oxygen O ₂	32	1.43	8.03	0.0803	0.11	7.1	0.07	0.1
Nitrogen N ₂	28.1	1.25	81.24	0.8124	1.02	71.82	0.72	0.9
Moisture (H ₂ O)	18.02	0.8	-	-	-	11.6	0.12	0.09
where $p=M/22.41$								
$\pi = r \times p$								

Document No.: ARLATL1270525 / 20251408

Visit No: 2

Year: 2025

Office: Trim

EPA Licence No.: W0004-04

Licence Holder: South Dublin County Council, AR08

Facility Location: Arthurstown Landfill

Rev.No: 1

Calculation of Stack Gas Densities		
Determinant	Units	Result
Dry Density (STP), P STD	kg.m ⁻³	1.344
Wet Density (STP), P STW	kg.m ⁻³	1.288
Dry Density (Actual), P Actual	kg.m ⁻³	-
Average wet Density (Actual), P Actual W	kg.m ⁻³	-
Where		
P STD = sum of component concentrations, kg/m ³ (excluding water vapour)		
$P_{STW} = (P_{STD} + p_{H_2O}) / (1 + (p_{H_2O} / 0.8036))$		
$P_{actual} = P_{STD} \times (T_{STP} / (P_{STP})) \times (P_a / T_a)$		
$P_{actual\ W} \text{ (at each sampling point)} = P_{STW} \times (T_s / P_s) \times (P_a / T_a)$		

Document No.: ARLATL1270525 / 20251408

Visit No: 2

Year: 2025

Office: Trim

EPA Licence No.: W0004-04

Licence Holder: South Dublin County Council, AR08

Facility Location: Arthurstown Landfill

Rev.No: 1

Sampling Plane Validation Criteria	Value	Units	Requirement	Compliance	Method
Lowest Differential Pressure	-	Pa	>5 Pa	N/A	EN16911:2013
Lowest Gas Velocity	-	m/s	-	N/A	-
Highest Gas Velocity	-	m/s	-	N/A	-
Ratio of Above	-	:1	<3:1	N/A	EN16911:2013
Mean Velocity	-	m/s	-	N/A	-
Angle of flow with regard to duct axis	-	degrees	< 15	N/A	EN16911:2013
No local negative flow	-	-	-	N/A	-
Homogeneous flow stream/gas velocity	-	-	-	N/A	-

Calculation of stack Gas Velocity, V	
Velocity at Traverse Point, $V = K_{cp} * \text{Sqrt}((2 * DP) / \text{Density})$	-
Where	
K_{pt} = Pitot tube calibration coefficient	-
Compressibility correction factor, assumed at a constant 0.998	0.998

Gas Volumetric Flowrate	Units	Result
Gas Volumetric Flow Rate (Actual)	$m^3.h^{-1}$	-
Gas Volumetric Flow Rate (STP, Wet)	$m^3.h^{-1}$	-
Gas Volumetric Flowrate (STP, Dry)	$m^3.h^{-1}$	-
Gas Volumetric Flowrate REF to Oxygen	$m^3.h^{-1}$	-

Standard uncertainty of velocity (m/s)	-	Expanded uncertainty of velocity (m/s)	-	Volume flow rate expanded uncertainty (m^3/hr)	-
--	---	--	---	--	---

Document No.: ARLATL1270525 / 20251408
Visit No: 2
Year: 2025
Office: Trim

EPA Licence No.: W0004-04
Licence Holder: South Dublin County Council, AR08
Facility Location: Arthurstown Landfill
Rev.No: 1

IV. Appendix 3 - Individual parameter sampling details and results

Document No.: ARLATL1270525 / 20251408
 Visit No: 2
 Year: 2025
 Office: Trim

EPA Licence No.: W0004-04
 Licence Holder: South Dublin County Council, AR08
 Facility Location: Arthurstown Landfill
 Rev.No: 1

Carbon Monoxide Quality Assurance


Sampling Details				
Stack ID	AR08			
Parameter	Units	Run 1	Run 2	Run 3
Sampling Times	-	09:42	-	-
Sampling Dates	-	27/05/2025	-	-
Instrument Range	ppm	1000	-	-
Span Gas Value	ppm	680	-	-
Acceptable Gas Range	-	Y	-	-
Quality Assurance	Units	Run 1	Run 2	Run 3
Conditioning Unit Temperature	°C	2	-	-
Average Temperature	< °C	2	-	-
Allowable Temperature	-	4	-	-
Temperature Acceptable	-	Y	-	-
Pump flow rate	l/min	0.5	-	-
Zero Drift	Units	Run 1	Run 2	Run 3
Zero Down Sampling Line (Pre)	ppm	1	-	-
Zero Down Sampling Line (Post)	ppm	2	-	-
Zero Drift	ppm	-1	-	-
Allowable Zero Drift (5%)	ppm	34	-	-
Zero Drift Acceptable	Y <2%/Y 2-5%/N>5%	Y <2%	-	-
Zero Drift	%	-0.15	-	-
Span Drift	Units	Run 1	Run 2	Run 3
Span Down Sampling Line (Pre)	ppm	680	-	-
Span Down Sampling Line (Post)	ppm	683	-	-
Span Drift	ppm	-3	-	-
Allowable Span Drift (5%)	ppm	34	-	-
Span Drift Acceptable (Y/N)	Y <2%/Y 2-5%/N>5%	Y <2%	-	-
Span Drift	%	-0.44	-	-
Leak Check	Units	Run 1	Run 2	Run 3
Span Gas Conc.	ppm	680	-	-
Recorded Conc. down Line	ppm	680	-	-
Leak check acceptable (< 2%)	(Y/N)	Y <2%	-	-
Test Conditions	Units	Run 1	Run 2	Run 3
Run Ambient Temperature Range	°C	14	-	-

Carbon Monoxide Results & Sampling Details

Parameter	Units	Run 1	Run 2	Run 3	Mean
Concentration	mg.m ⁻³	1001.62	-	-	-
Uncertainty	mg.m ⁻³	-	-	-	-
Mass Emission	kg.h ⁻¹	-	-	-	-

General Sampling Information	
Parameter	Value
Standard	EN15058
Technical Procedure	SOP2004
Probe material	SS
Filtration Type/Size	PTFE
Heated Head Filter Used	Yes
Heated Line Temperature	180
Span Gas Reference Number	ASLTM22ING530
Span Gas Expiry Date	27-Jun
Span Gas Start Pressure (bar)	40
Gas Cylinder Concentration (ppm)	680
Span Gas Uncertainty (%)	<2
Zero Gas Type	N
Number of Sampling Lines Used	1
Number of Sampling Points Used	1
Sample Point I.D's	AR08
Reference Conditions	
Temperature (K)	273.15
Pressure (kPa)	101.3
Gas (Wet or Dry)	Dry
Oxygen	5

Carbon Monoxide Trend

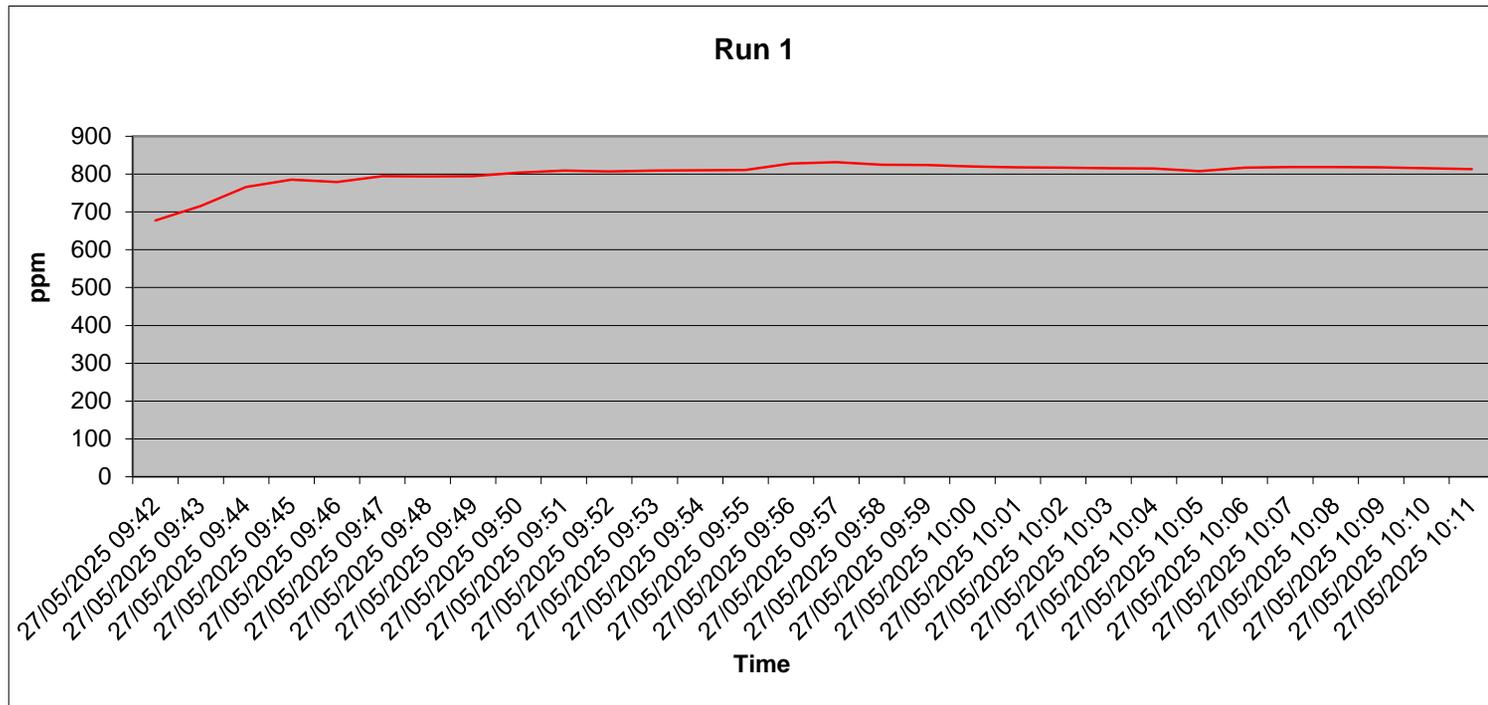

Carbon Monoxide Measurement Uncertainty

Measured Quantities	Units	Run 1	Run 2	Run 3
Certified Range of Analyser	ppm	1.36-1000	-	-
Operational Range of Analyser	ppm	1000	-	-
Measured Reading	ppm	801.3	-	-
Measured Quantities				
Measured Quantities	Units	Run 1	Run 2	Run 3
Nonlinearity	%	0.9	-	-
Temperature Dependent Zero drift	%	0.14	-	-
Temperature Dependent Span drift	%	-0.12	-	-
Cross-sensitivity	%	0.08	-	-
Leak	%	0	-	-
Calibration Gas Uncertainty	%	<2	-	-
Parameter				
Parameter	Units	Run 1	Run 2	Run 3
Combined uncertainty	mg.m ⁻³	12.75	-	-
Expanded uncertainty	mg.m ⁻³	25.51	-	-
Uncertainty corrected to std conds.	mg.m ⁻³	-	-	-
Expanded uncertainty expressed with a level of confidence of 95%	% of ELV	-	-	-
Expanded uncertainty expressed with a level of confidence of 95%	mg.m ⁻³	-	-	-
Expanded uncertainty expressed with a level of confidence of 95%	% of value	-	-	-
Requirement in standard is for uncertainty to be < 10% at ELV at standard conditions				

Document No.: ARLATL1270525 / 20251408
 Visit No: 2
 Year: 2025
 Office: Trim

EPA Licence No.: W0004-04
 Licence Holder: South Dublin County Council, AR08
 Facility Location: Arthurstown Landfill
 Rev.No: 1

Oxides of Nitrogen Quality Assurance


Sampling Details				
Stack ID	AR08			
Parameter	Units	Run 1	Run 2	Run 3
Sampling Times	-	09:42	-	-
Sampling Dates	-	27/05/2025	-	-
Instrument Range	ppm	250	-	-
Span Gas Value	ppm	165	-	-
Acceptable Gas Range	-	Yes	-	-
Quality Assurance	Units	Run 1	Run 2	Run 3
Conditioning Unit Temperature	°C	2	-	-
Average Temperature	< °C	2	-	-
Allowable Temperature	-	4	-	-
Temperature Acceptable	-	Y	-	-
Pump flow rate	l/min	0.5	-	-
Zero Drift	Units	Run 1	Run 2	Run 3
Zero Down Sampling Line (Pre)	ppm	0.1	-	-
Zero Down Sampling Line (Post)	ppm	0.1	-	-
Zero Drift	ppm	0	-	-
Allowable Zero Drift (5%)	ppm	8.25	-	-
Zero Drift Acceptable	Y <2%/Y 2-5%/N >5%	Y <2%	-	-
Zero Drift	%	0	-	-
Span Drift	Units	Run 1	Run 2	Run 3
Span Down Sampling Line (Pre)	ppm	165	-	-
Span Down Sampling Line (Post)	ppm	164.2	-	-
Span Drift	ppm	0.8	-	-
Allowable Span Drift (5%)	ppm	8.25	-	-
Span Drift Acceptable (Y/N)	Y <2%/Y 2-5%/N >5%	Y <2%	-	-
Span Drift	%	0.48	-	-
Leak Check	Units	Run 1	Run 2	Run 3
Span Gas Conc.	ppm	165	-	-
Recorded Conc. down Line	ppm	165	-	-
Leak check acceptable (< 2%)	(Y/N)	Y <2%	-	-
Test Conditions	Units	Run 1	Run 2	Run 3
Run Ambient Temperature Range	°C	14	-	-

Oxides of Nitrogen Results & Sampling Details

Parameter	Units	Run 1	Run 2	Run 3	Mean
Concentration	mg.m ⁻³	232.4	-	-	-
Uncertainty	mg.m ⁻³	-	-	-	-
Mass Emission	kg.h ⁻¹	-	-	-	-

General Sampling Information	
Parameter	Value
Standard	EN14792
Technical Procedure	SOP2002
Probe material	SS
Filtration Type/Size	PTFE
Heated Head Filter Used	Yes
Heated Line Temperature	180
Date & Result of last converter check	95.5 18/04/2025
Span Gas Reference Number	ASLTM23ING511
Span Gas Expiry Date	25-Jun
Span Gas Start Pressure (bar)	40
Gas Cylinder Concentration (ppm)	165
Span Gas Uncertainty (%)	<2
Zero Gas Type	N
Number of Sampling Lines Used	1
Number of Sampling Points Used	1
Sample Point I.D's	AR08
Reference Conditions	
Temperature (K)	273.15
Pressure (kPa)	101.3
Gas (Wet or Dry)	Dry
Oxygen	5

Oxides of Nitrogen Trend

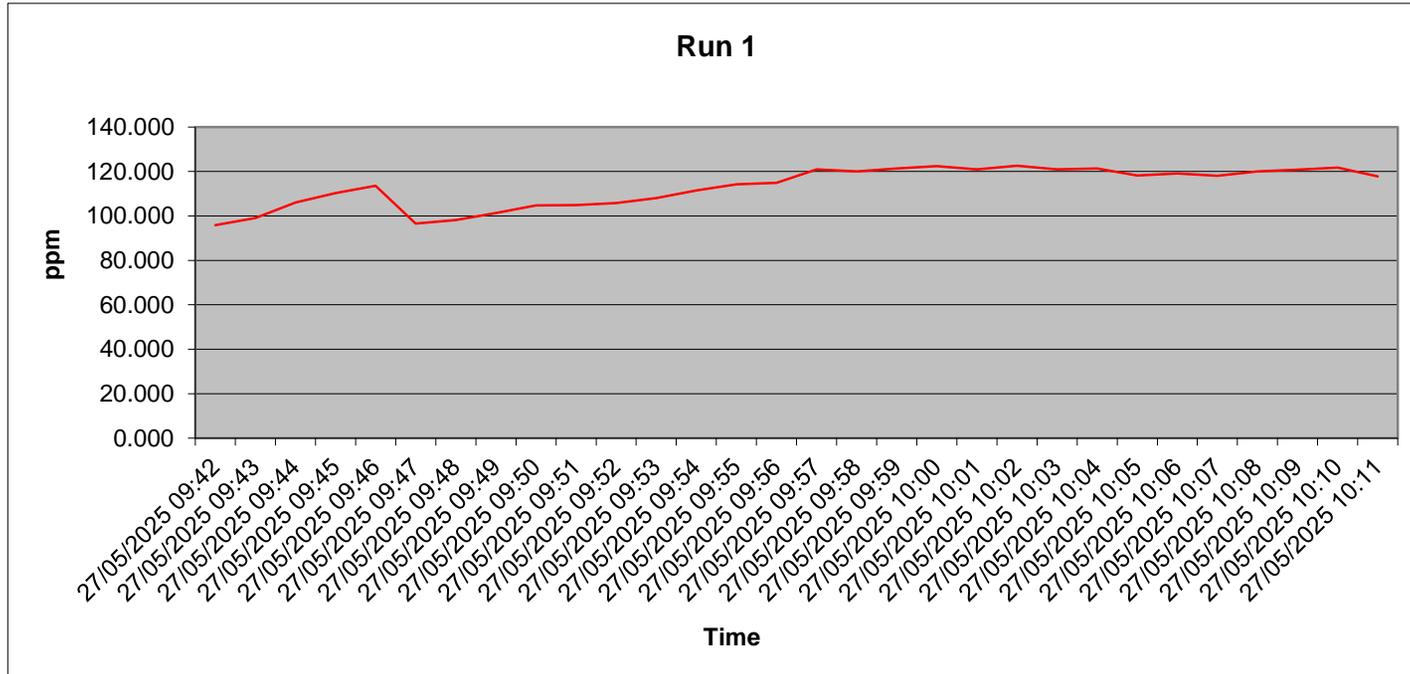

Document No.: ARLATL1270525 / 20251408
 Visit No: 2
 Year: 2025
 Office: Trim

EPA Licence No.: W0004-04
 Licence Holder: South Dublin County Council, AR08
 Facility Location: Arthurstown Landfill
 Rev.No: 1


Oxides of Nitrogen Measurement Uncertainty

Measured Quantities	Units	Run 1	Run 2	Run 3
Certified Range of Analyser	ppm	0.87-1000	-	-
Operational Range of Analyser	ppm	250	-	-
Measured Reading	ppm	113.2	-	-
Measured Quantities				
Measured Quantities	Units	Run 1	Run 2	Run 3
Nonlinearity	%	1.4	-	-
Temperature Dependent Zero drift	%	-0.04	-	-
Temperature Dependent Span drift	%	-0.25	-	-
Cross-sensitivity	%	0.5	-	-
Leak	%	0	-	-
Calibration Gas Uncertainty	%	<2	-	-
Mass Flow Controllers (Dilution) Uncertainty	%	<1	-	-
NOx Converter Efficiency	%	95.5	-	-
Parameter				
Parameter	Units	Run 1	Run 2	Run 3
Combined uncertainty	mg.m ⁻³	6.68	-	-
Expanded uncertainty	mg.m ⁻³	13.36	-	-
Uncertainty corrected to std conds.				
	mg.m ⁻³	-	-	-
Expanded uncertainty expressed with a level of confidence of 95%				
	% of ELV	-	-	-
Expanded uncertainty expressed with a level of confidence of 95%				
	mg.m ⁻³	-	-	-
Expanded uncertainty expressed with a level of confidence of 95%				
	% of value	-	-	-
Requirement in standard is for uncertainty to be < 10% at ELV at standard conditions				

Oxygen Quality Assurance

Sampling Details				
Stack ID	AR08			
Parameter	Units	Run 1	Run 2	Run 3
Sampling Times	-	09:42	-	-
Sampling Dates	-	27/05/2025	-	-
Instrument Range	ppm	25	-	-
Span Gas Value	ppm	20.9	-	-
Acceptable Gas Range	-	Y	-	-
Quality Assurance	Units	Run 1	Run 2	Run 3
Conditioning Unit Temperature	°C	2	-	-
Average Temperature	< °C	2	-	-
Allowable Temperature	-	4	-	-
Temperature Acceptable	-	Y	-	-
Pump flow rate	l/min	0.5	-	-
Zero Drift	Units	Run 1	Run 2	Run 3
Zero Down Sampling Line (Pre)	%	0.1	-	-
Zero Down Sampling Line (Post)	%	0	-	-
Zero Drift	%	0.1	-	-
Allowable Zero Drift (5%)	%	1.05	-	-
Zero Drift Acceptable (Y/N)	Y <2%/Y 2-5%/N>5%	Y <2%	-	-
Span Drift	Units	Run 1	Run 2	Run 3
Span Down Sampling Line (Pre)	%	20.9	-	-
Span Down Sampling Line (Post)	%	20.8	-	-
Span Drift	%	0.1	-	-
Allowable Span Drift (5%)	%	1.05	-	-
Span Drift Acceptable (Y/N)	Y <2%/Y 2-5%/N>5%	Y <2%	-	-
Leak Check	Units	Run 1	Run 2	Run 3
Span Gas Conc.	%	20.9	-	-
Recorded Conc. down Line	%	20.9	-	-
Leak check acceptable (< 2%)	(Y/N)	Y <2%	-	-
Test Conditions	Units	Run 1	Run 2	Run 3
Run Ambient Temperature Range	°C	14	-	-
Combined uncertainty	% vol	0.17	-	-
% of value	%	2.07	-	-
Expanded uncertainty	% of value	4.14	-	-
Expanded uncertainty	% vol	0.33	-	-

Oxygen trend

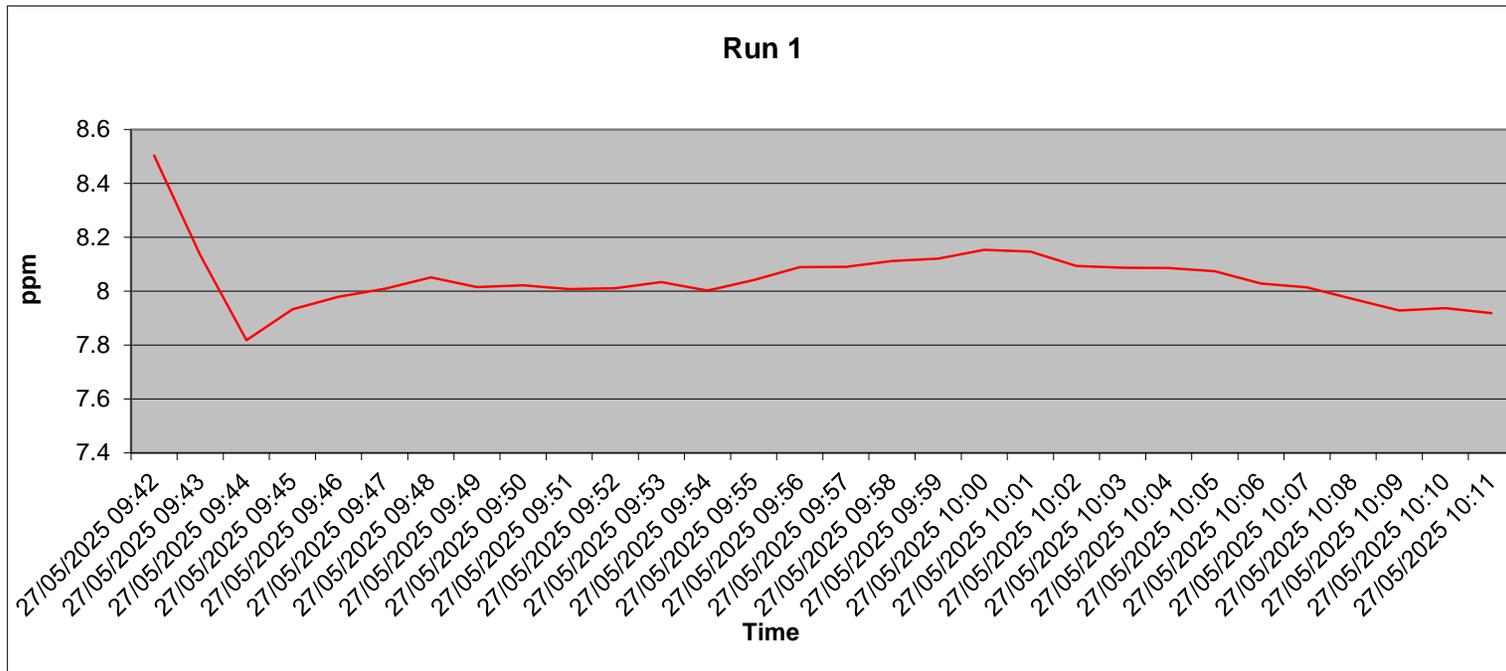

Document No.: ARLATL1270525 / 20251408
 Visit No: 2
 Year: 2025
 Office: Trim

EPA Licence No.: W0004-04
 Licence Holder: South Dublin County Council, AR08
 Facility Location: Arthurstown Landfill
 Rev.No: 1

Carbon Dioxide Quality Assurance

Sampling Details				
Stack ID	AR08			
Parameter	Units	Run 1	Run 2	Run 3
Sampling Times	-	09:42	-	-
Sampling Dates	-	27/05/2025	-	-
Instrument Range	ppm	20	-	-
Span Gas Value	ppm	15	-	-
Acceptable Gas Range	-	Y	-	-
Quality Assurance	Units	Run 1	Run 2	Run 3
Conditioning Unit Temperature	°C	2	-	-
Average Temperature	< °C	2	-	-
Allowable Temperature	-	4	-	-
Temperature Acceptable	-	Y	-	-
Pump flow rate	l/min	0.5	-	-
Zero Drift	Units	Run 1	Run 2	Run 3
Zero Down Sampling Line (Pre)	%	0.1	-	-
Zero Down Sampling Line (Post)	%	0	-	-
Zero Drift	%	0.1	-	-
Allowable Zero Drift (4%)	%	0.6	-	-
Zero Drift Acceptable	Y <2%/Y 2-4% /N>4%	Y <2%	-	-
Span Drift	Units	Run 1	Run 2	Run 3
Span Down Sampling Line (Pre)	%	15	-	-
Span Down Sampling Line (Post)	%	15	-	-
Span Drift	%	0	-	-
Allowable Span Drift (4%)	%	0.6	-	-
Span Drift Acceptable	Y <2%/Y 2-4% /N>4%	Y <2%	-	-
Leak Check	Units	Run 1	Run 2	Run 3
Span Gas Conc.	ppm	15	-	-
Recorded Conc. down Line	ppm	15	-	-
Leak check acceptable (< 2%)	(Y/N)	Y <2%	-	-
Test Conditions	Units	Run 1	Run 2	Run 3
Run Ambient Temperature Range	°C	14	-	-
Combined uncertainty	% vol	0.18	-	-
% of value	%	1.65	-	-
Expanded uncertainty	% of value	3.3	-	-
Expanded uncertainty	% vol	0.35	-	-

Document No.: ARLATL1270525 / 20251408
 Visit No: 2
 Year: 2025
 Office: Trim


EPA Licence No.: W0004-04
 Licence Holder: South Dublin County Council, AR08
 Facility Location: Arthurstown Landfill
 Rev.No: 1

Carbon Dioxide Results & Sampling Details

Parameter	Units	Run 1	Run 2	Run 3	Mean
Concentration	%	10.72	-	-	-
Uncertainty	%	0.35	-	-	-

General Sampling Information	
Parameter	Value
Standard	ISO12039
Technical Procedure	SOP 2045
Probe material	SS
Filtration Type/Size	Ceramic
Heated Head Filter Used	Yes
Heated Line Temperature	180
Span Gas Reference Number	ASLTM22ING505
Span Gas Expiry Date	28-Jun
Span Gas Start Pressure (bar)	40
Gas Cylinder Concentration (ppm)	15
Span Gas Uncertainty (%)	<2
Zero Gas Type	N
Number of Sampling Lines Used	1
Number of Sampling Points Used	1
Sample Point I.D's	AR08
Reference Conditions	
Temperature (K)	273.15
Pressure (kPa)	101.3
Gas (Wet or Dry)	Dry
Oxygen	5

Carbon Dioxide Trend

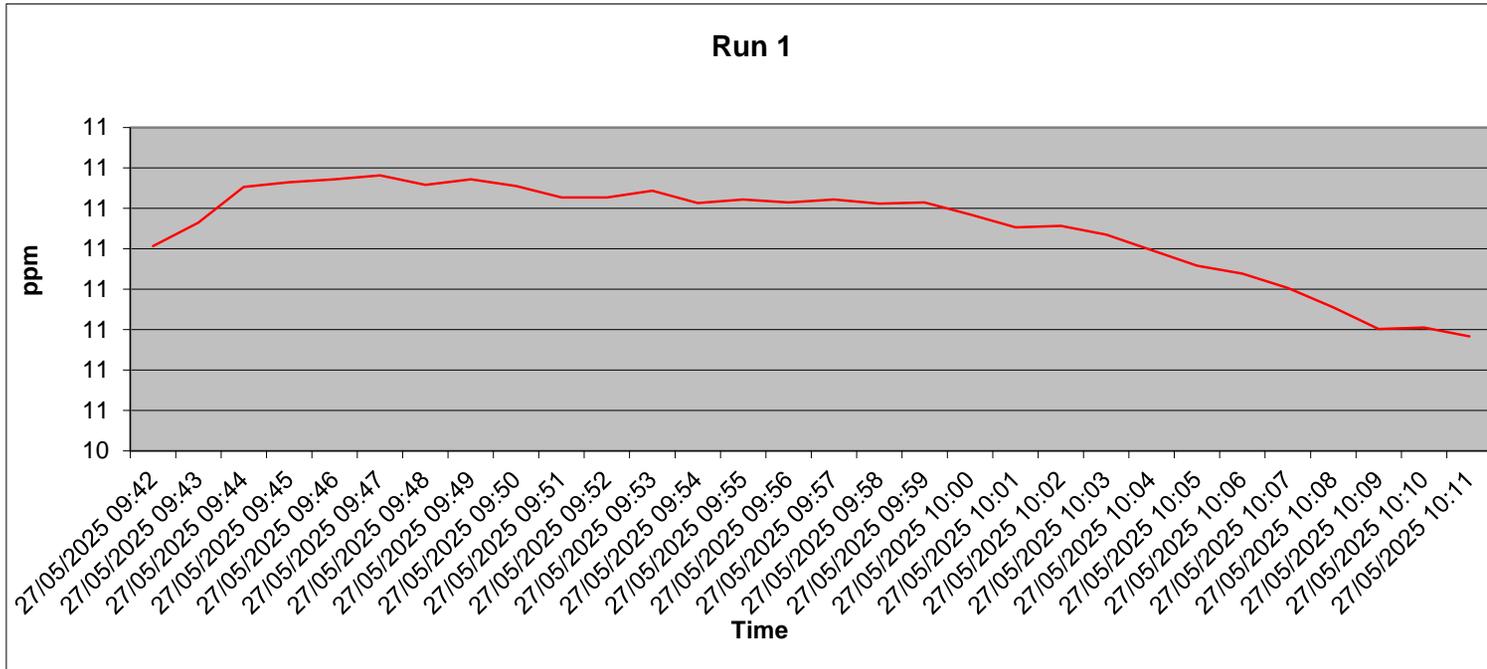

Uncert Sheets

CO Uncert

Uncertainty calculation for Gaseous Measurement CO

Limit value	1400 mg/m3 (corre Cal gas conc	850 mg.m-3
Measured concentration	1001.62 mg/m3 Full Scale	1000 mg/m3
Measured concentration	1237.95 mg/m3 (Corrected)	

Correction for reference conditions					
		O2, %	Moisture,	Pressure, KPa	Temperature, K
	ref	5.00	0.00	101.30	273.00
	measured	8.04	0.00	-	#VALUE!
	Uncert	0.35	1.00	0.00	1.00
Factors		1.23	1.00	#VALUE!	#VALUE!
Uncertainty in factor		0.03	0.01	#VALUE!	#VALUE!
Correction Factor		#VALUE!	uf	#VALUE!	

Performance characteristics	Value		specification
Response time	180	seconds	180.000
Logger sampling interval	60	seconds	
Measurement period	32	minutes	
Number of readings in measurement	32		
Repeatability at zero	0.25	% full scale	<1 % range
Repeatability at span level	0.15	% full scale	<2 % range
Deviation from linearity(lack of fit)	0.7	% of value	<2 % range
Zero drift	-1.25	mg/m3	<2% range / 24hr
Span drift	-3.75	mg/m3	<2% range/24hr
volume or pressure flow dependence	0.02	% of full scale/3 kPa	<2 % / 3 kPa
atmospheric pressure dependence	0.8	% of full scale/2 kPa	<3% / 2 kPa
ambient temperature dependence	0.01	% full scale/10K	<3% range / 10 K
N2O (mg/m3)	20	0.2 mg/m3	
CO2 (% vol)	15	0.2 mg/m3	
CH4 (mg/m3)	40	0.7 mg/m3	
H2O (% vol)	20	0.2 mg/m3	
dependence on voltage	0.1	% full scale/10V	<2% range
losses in the line (leak)	0.00	% of value	< 0.1%vol /10 volt
Uncertainty of calibration gas	2	% of value	< 2% of value

Effect of drift
-5.67 mg/m3
-0.57 % full scale

	min	max	value at calib
flow	95.00	105	100 kPa
pressure	100.76	100.92	100.88 kPa
temp	287	288.5	287.5 K
N2O range	0	40	0 mg/m3
CO2 range	0	15	0 %vol
CH4 range	0	57	0 mg/m3
H2O range	0	1	0 %vol
Voltage	93	121	110 V

Performance characteristic	Uncertainty	Value of uncertainty quantity	mg/m3
Standard deviation of repeatability at zero	ur0	for mean	use rep at span
Standard deviation of repeatability at span level	urs	for mean	0.27
Lack of fit	ufit		4.05
Drift	u0dr		-3.27

Uncert Sheets

volume or pressure flow dependence		uspres			0.19		
atmpsheric pressure dependence		uapres			0.24		
ambient temperature dependence		utemp			0.00		
N2O (mg/m3)		uinterf			0.23	Use largest of sum of all positive or all negative influences	
CO2 (% vol)		uinterf			0.12		0.93 all +ves
CH4 (mg/m3)		uinterf			0.58		0 all -ves
H2O (% vol)		uinterf			0.01	0.93 largest	Criteria sum <4% range 20.03242188
Dependence on voltage		uvolt			0.86	Value to use for intereference uncertainty	
losses in the line (leak)		uleak			0.00	uint	0.93
Uncertainty of calibration gas		ucalib			11.57		
Uncertianty in factor		uf			#VALUE!		

Measurement uncertainty			1237.95	mg/m3
Combined uncertainty			12.75	mg/m3
Expanded uncertainty	k =	2	25.51	mg/m3
Uncertainty corrected to std conds			#VALUE!	mg/m3
Expanded uncertainty	expressed with a level of		#VALUE!	% ELV
Expanded uncertainty	expressed with a level of		#VALUE!	mg.m-3
Expanded uncertainty	expressed with a level of		#VALUE!	% value

Requirement in standard is for uncertainty to be < 10% at ELV at standard conditions

Note: Enter values into green boxes
 Dark blue boxes indicate information that can be obtained from MCERTS tests

Developed for the STA by R Robinson, NPL

NOx Uncert

Uncertainty calculation for Gaseous Measurement NOx EN14792

RUN 1			
Limit value	500	mg/m3 (corre Cal gas conc	338.745 mg.m-3 (NO2)
Measured concentration	113	ppm	
Measured concentration	232.40	mg/m3 (101.3 Full Scale	513.25 mg/m3 (NO2)
Measured concentration	287.24	mg/m3 (Corrected)	
NO/NO2 ratio	100.00		
Gas		NO	
Full Scale		250	ppm
Cal gas conc		165	ppm

Correction for reference conditions					
		O2, %	Moisture,	Pressure, KPa	Temperature, K
	ref	5.00	0.00	101.30	273.00
	measured	8.04	0.00	-	#VALUE!
	Uncert	0.35	0.00	0.00	1.00
Factors		1.23	1.00	#VALUE!	#VALUE!
Uncertainty in factor		0.03	0.00	#VALUE!	#VALUE!

Uncert Sheets

Conversion	2.053
------------	-------

Correction Factor	#VALUE!	uf	#VALUE!
-------------------	---------	----	---------

Performance characteristics	Value		specification
Response time	180	seconds	180.000
Logger sampling interval	60	seconds	
Measurement period	32	minutes	
Number of readings in measurement	32		
Repeatability at zero	0.03	% full scale	<1 % range
Repeatability at span level	0.06	% full scale	<2 % range
Deviation from linearity(lack of fit)	0.2	% of value	<2 % range
Zero drift	0.00	mg/m3	<2% range / 24hr
Span drift	1.64	mg/m3	<2% range/24hr
volume or pressure flow dependence	0	%of full scale/kPa	<2 % / kPa
atmospheric pressure dependence	0	%of value /kPa	<3% / kPa
ambient temperature dependence	0.3	% full scale/10K	<3% range / 10 K
NH3 (mg/m3)	20	0.0	mg/m3
CO2 (% vol)	15	0.2	mg/m3
H2O (% vol)	30	0.0	mg/m3
dependence on voltage	0.1	% full scale/10V	<2% range
losses in the line (leak)	0.00	% of value	< 0.1%vol /10 volt
Converter efficiency	95.5	%	>95%
Uncertainty of calibration gas	2	% of value	< 2% of value

Effect of drift
1.39 mg/m3
0.27 % full scale

	min	max	value at calib	
flow	95.00	105	100	kPa
pressure	101.30	101.3	101.3	kPa
temp	289	289	289	K
NH3 range	0	0	0	mg/m3
CO2 range	0	15	0	%vol
H2O range	0	0	0	%vol
Voltage	93	121	110	V

Performance characteristic	Uncertainty	Value of uncertainty quantity	mg/m3
Standard deviation of repeatability at zero	ur0	for mean	use rep at span
Standard deviation of repeatability at span level	urs	for mean	0.05
Lack of fit	ufit		0.27
Drift	u0dr		0.80
volume or pressure flow dependence	uspres		0.00
atmospheric pressure dependence	uapres		0.00
ambient temperature dependence	utemp		0.00
NH3	uintenf		0.00
CO2 (% vol)	uintenf		0.12
H2O (% vol)	uintenf		0.00
Dependence on voltage	uvolt		0.44
losses in the line (leak)	uleak		0.00
Uncertainty of calibration gas	ucalib		2.68
converter efficiency	uceff		6.04
Uncertainty in factor	uf		#VALUE!

Use largest of sum of all positive or all negative influences	
0.12 all +ves	Criteria sum <4% range 4.648088229
0 all -ves	
0.12 largest	
Value to use for intereference uncertainty	
uint	0.12

Measurement uncertainty	287.24	mg/m3
-------------------------	--------	-------

Uncert Sheets

Combined uncertainty			6.68	mg/m3
Expanded uncertainty	k =	2	13.36	mg/m3
Uncertainty corrected to std conds				
			#VALUE!	mg/m3
Expanded uncertainty	expressed with a level of		#VALUE!	% ELV
Expanded uncertainty	expressed with a level of		#VALUE!	mg.m-3
Expanded uncertainty expressed with a level of				
			#VALUE!	% value

Requirement in standard is for uncertainty to be < 10% at ELV at standard conditions

Note: Enter values into green boxes
 Dark blue boxes indicate information that can be obtained from MCERTS tests

Developed for the STA by R Robinson, NPL

corrected drift to be based on mg/m3 reading and the correction alert to be based on % full scale

O₂ Uncert

Run 1

Uncertainty calculation for Gaseous Measurement Oxygen EN14789

Limit value	n/a	%vol	Calibration gas	20.9	%vol
Measured concentration	8.04	%vol	Full Scale	25	%vol

Performance characteristics	Value			specification
Response time	180	seconds		< 200 s
Logger sampling interval	60	seconds		
Measurement period	32	minutes		
Number of readings in measurement	32	Assuming 1 minute collected over 1 hour		
Repeatability at zero	0.015	% by volume	stdev	<0.2 % range
Repeatability at span level	0.014	% by volume	stdev	<0.4 % range
Deviation from linearity	0.13	% vol	+/-	<0.3 % volume
Zero drift (during measurement period)	0.10	% vol at zero level	+/-	<2% of volume / 24hr

Effect of drift
0.14 % vol
0.55 % full scale

range of variation from conditions at calibration

Uncert Sheets

						min	max	value at calib
Span drift (during measurement period)	0.10	% vol at span level	+/-	<2% volume/24hr				
volume or pressure flow dependence	0	% of fs / 10l/h	+ 5 l/h	<1% range	flow	5	15	10 l/h
atmospheric pressure dependence	0.3	% of fs/kPa	+ 2kPa	< 1.5 % range	pressure	99.00	101	100 kPa
ambient temperature dependence	-0.07	% by volume /10K	+ 15K	<0.3% volume 10 K	temp	280	285	285 K
CO2 (% vol)	15	0.07	% by volume per	15	CO2 range	8	15	0 % vol
NO (mg/m3)	300	0.02	% by volume per	300	NO range	100	150	0 mg/m3
NO2 (mg/m3)	30	0	% by volume per	30	NO2 range	5	7.5	0 mg/m3
Combined interference	0.56	% range		<2% range	Voltage	105	115	110 V
Dependence on voltage	0.1	% by volume /10V	+ 5%	< 0.1%vol /10 volt				
Losses in the line (leak)	0.00	% of value		< 2% of value				
Uncertainty of calibration gas	2	% of value						

Performance characteristic	Uncertainty	Value of uncertainty quantity	% vol
Standard deviation of repeatability at zero	ur0	for mean	Only use rep at span
Standard deviation of repeatability at span level	urs	for mean	0.00
Lack of fit	ufit		0.08
Drift	u0dr		0.08
volume or pressure flow dependence	uspres		0.00
atmospheric pressure dependence	uapres		0.04
ambient temperature dependence	utemp		-0.02
CO2			0.05
NO			0.01
NO2			0.00
Combined interference (from mcerts)			0.08
dependence on voltage	uvolt		0.03
losses in the line (leak)	uleak		0.00
Uncertainty of calibration gas	ucalib		0.09

Use largest of sum of all positive or all negative influences

0.06 all +ves
0 all -ves
0.06 largest

Value to use for intereference uncertainty
 uint 0.06

Measurement uncertainty		8.04	%vol
Combined uncertainty		0.17	%vol
% of value		2.07	%
Coverage factor k =	2		
Expanded uncertainty	expressed with a level of confidence	4.14 % of value	
Expanded uncertainty	expressed with a level of confidence	0.33 % vol	

Requirement for SRM is that Uncertainty should be < 6% of value, on a dry gas basis

Note: Enter values into green boxes
 Dark blue boxes indicate information that can be obtained from MCERTS tests
 Purple boxes are from manufacturer specification, or CEN standard as MCERTS data not available

Uncert Sheets

Developed for the STA by R Robinson, NPL

corrected drift alert to be based on % full scale

CO₂ Uncert

Run 1

Uncertainty calculation for Gaseous Measurement Carbon Dioxide

Limit value	n/a	%vol	Calibration gas	15	%vol
Measured concentration	10.72	%vol	Full Scale	25	%vol

Performance characteristics	Value			specification
Response time	180	seconds		< 200 s
Logger sampling interval	60	seconds		
Measurement period	32	minutes		
Number of readings in measurement	32	Assuming 1 minute collected over 1 hour		
Repeatability at zero	0.015	% by volume	stdev	<0.2 % range
Repeatability at span level	0.014	% by volume	stdev	<0.4 % range
Deviation from linearity	0.13	% vol	+/-	<0.3 % volume
Zero drift (during measurement period)	0.10	% vol at zero level	+/-	<2% of volume / 24hr
Span drift (during measurement period)	0.00	% vol at span level	+/-	<2% volume/24hr
volume or pressure flow dependence	0	% of fs / 10l/h	+ - 5 l/h	<1% range
atmospheric pressure dependence	0.3	% of fs/kPa	+ - 2kPa	< 1.5 % range
ambient temperature dependence	-0.07	% by volume /10K	+ - 15K	<0.3% volume 10 K
CO ₂ (% vol)	15	0.07	% by volume per	15
NO (mg/m ³)	300	0.02	% by volume per	300
NO ₂ (mg/m ³)	30	0	% by volume per	30
Combined interference	0.56	% range		<2% range
Dependence on voltage	0.1	% by volume /10V	+ - 5%	< 0.1%vol /10 volt
Losses in the line (leak)	0.00	% of value		< 2% of value
Uncertainty of calibration gas	2	% of value		

Effect of drift
0.10 % vol
0.40 % full scale

	range of variation from conditions at calibration		
	min	max	value at calib
flow	5	15	10 l/h
pressure	99.00	101	100 kPa
temp	280	285	285 K
CO ₂ range	8	15	0 % vol
NO range	100	150	0 mg/m ³
NO ₂ range	5	7.5	0 mg/m ³
Voltage	105	115	110 V

Performance characteristic	Uncertainty	Value of uncertainty quantity	% vol
Standard deviation of repeatability at zero	ur0	for mean	Only use rep at span
Standard deviation of repeatability at span level	urs	for mean	0.00
Lack of fit	ufit		0.08
Drift	u0dr		0.06
volume or pressure flow dependence	uspres		0.00
atmospheric pressure dependence	uapres		0.04
ambient temperature dependence	utemp		-0.02

Uncert Sheets

CO2						0.05	Use largest of sum of all positive or all negative influences	
NO						0.01		0.06 all +ves
NO2						0.00		0 all -ves
Combined interference (from mcerts)						0.08		0.06 largest
dependence on voltage			uvolt			0.03	Value to use for intereference uncertainty	
losses in the line (leak)			uleak			0.00		uint 0.06
Uncertainty of calibration gas			ucalib			0.12		

Measurement uncertainty			10.72	%vol
Combined uncertainty			0.18	%vol
% of value			1.65	%
Coverage factor k =	2			
Expanded uncertainty	expressed with a level of confidence		3.30 % of value	
Expanded uncertainty	expressed with a level of confidence		0.35 % vol	

Requirement for SRM is that Uncertaintny should be < 6% of value, on a dry gas basis

Note: Enter values into green boxes
 Dark blue boxes indicate information that can be obtained from MCERTS tests
 Purple boxes are from manufacturer specification, or CEN standard as MCERTS data not available